www.alertus.com



# **Solution Overview**

## Featured Activation Methods



Alertus Activation Console



Alertus Activator App



Outcall/Autodialing DRMNS Services



ThreatWatcher™ Alert Monitoring (NOAA, Lightning, RSS)



**Emergency Buttons** 



Hotkeys USB Emergency Buttons




Fire Alarm Systems



3rd-Party Notification Services

\*Additional activation methods available

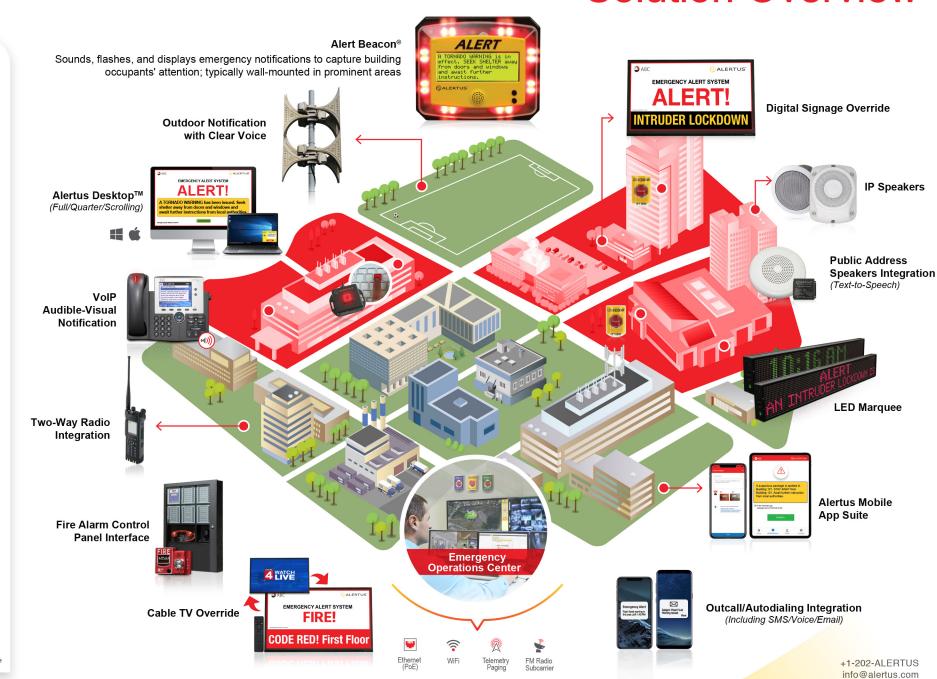



#### **ACTIVATE**

instant activation



Alertus Activation Console



Alertus Activator App



Outcall/ Autodialing DRMNS Services



Hotkeys **USB** Emergency Buttons



ThreatWatcher™ Alert Monitoring (NOAA, Lightning, RSS)



Emergency Buttons



**IPAWS** 



Common Alerting Protocol (CAP)



(FACP)

Fire Alarm Systems



PBX Phone System



Blue Light

Phone



I/O Sensors (e.g., AED Cabinet Entry)



3rd-Party Notification Services

## COMMUNICATE

seamless alert deployment

**ALERTUS** 

WALUS SERVER SOFTWARE &



reach everyone, everywhere



Indoor/Outdoor/Mobile





# NFPA 72 & MNS Code Compliance

The Alertus Unified Mass Notification System fully incorporates the standards and recommendations specified by the National Fire Alarm and Signaling Code (NFPA 72) by providing audible and visual alerting. In fact, the official NFPA 72 Handbook specifically features the Alert Beacon®.

The Alert Beacon fulfills the following key points of the NFPA 72 guidelines for in-building notification:

- Textual and graphical visible notification appliances shall be permitted to be used for primary or supplemental notification
- · Where audible notification is provided, mass notification systems shall also provide visual notification information to serve the hearing impaired or high-noise areas

Furthermore, NFPA 72 now allows public address systems and other facility infrastructure to integrate into the fire alarm system. The Alertus System accomplishes this with its unique cabinet-level text-to-speech integration module for fire alarm and public address systems.

The Alertus System's ability to provide immediate audible-visual alerting through multiple alerting modalities and its unparalleled integration capabilities make it the trusted and reliable solution to meet HEOA, ADA, UFC, and FEMA mass notification guidelines for organizations in any industry.

Learn more at alertus.com/compliance.



Americans with Disability Act Section 508 compliance



**Higher Education Opportunity Act** Clery Act (20 U.S.C. § 1092, et al)



IPAWS compliance CAP compliance



Unified Facility Criteria (UFC) 4-021-01 Mass Notification Systems (Release: 04/09/2008)